



Effect of surface loading fluctuationson ammonium removal during rapid sand filtration

Tatari, Karolina; Smets, Barth F.; Nielsen, P. B.; Lind, S.; Albrechtsen, Hans-Jørgen

Publication date:
2012

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):

Tatari, K., Smets, B. F., Nielsen, P. B., Lind, S., & Albrechtsen, H-J. (2012). *Effect of surface loading fluctuationson ammonium removal during rapid sand filtration*. Poster session presented at 2012 Water Quality Technology Conference and Exposition (WQTC), Toronot, Ontario, Canada.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Effect of surface loading fluctuations on ammonium removal during rapid sand filtration

Karolina Tatari^{a*}, Barth F. Smets^a, Peter B. Nielsen^b, Søren Lind^c, Hans-Jørgen Albrechtsen^a

^a Department of Environmental Engineering, Bygning 113, DTU, 2800, Lyngby, Denmark, ^b Krüger A/S Gladsaxevej 363 Søborg, 2860 Denmark, ^c Københavns Energi, Ørestads Boulevard 35, 2300 Copenhagen S., Denmark
*kaot@env.dtu.dk

Insert picture
of you here
10 x 8 cm
Or Remove

Introduction

- Rapid sand filtration is used in drinking water treatment to remove particles and inorganic compounds such as NH_4^+ , Fe^{+2} & Mn^{+2}
- NH_4^+ is removed biologically by microorganisms attached on the sand
- About 25% of waterworks in Denmark exceed the effluent NH_4^+ guideline of 0.05 mg/L.
- Loading can often change due to switching between abstraction wells with different water quality
- Loading that exceeds a filter's removal capacity may cause transient ammonium breakthrough

Research question:

In which operating region have NH_4^+ loading changes no effect a filter's performance?

Objectives

- Investigate the relationship between NH_4^+ loading and effluent NH_4^+ concentration in a filter
- Identify the loading region where loading changes do not affect effluent concentration

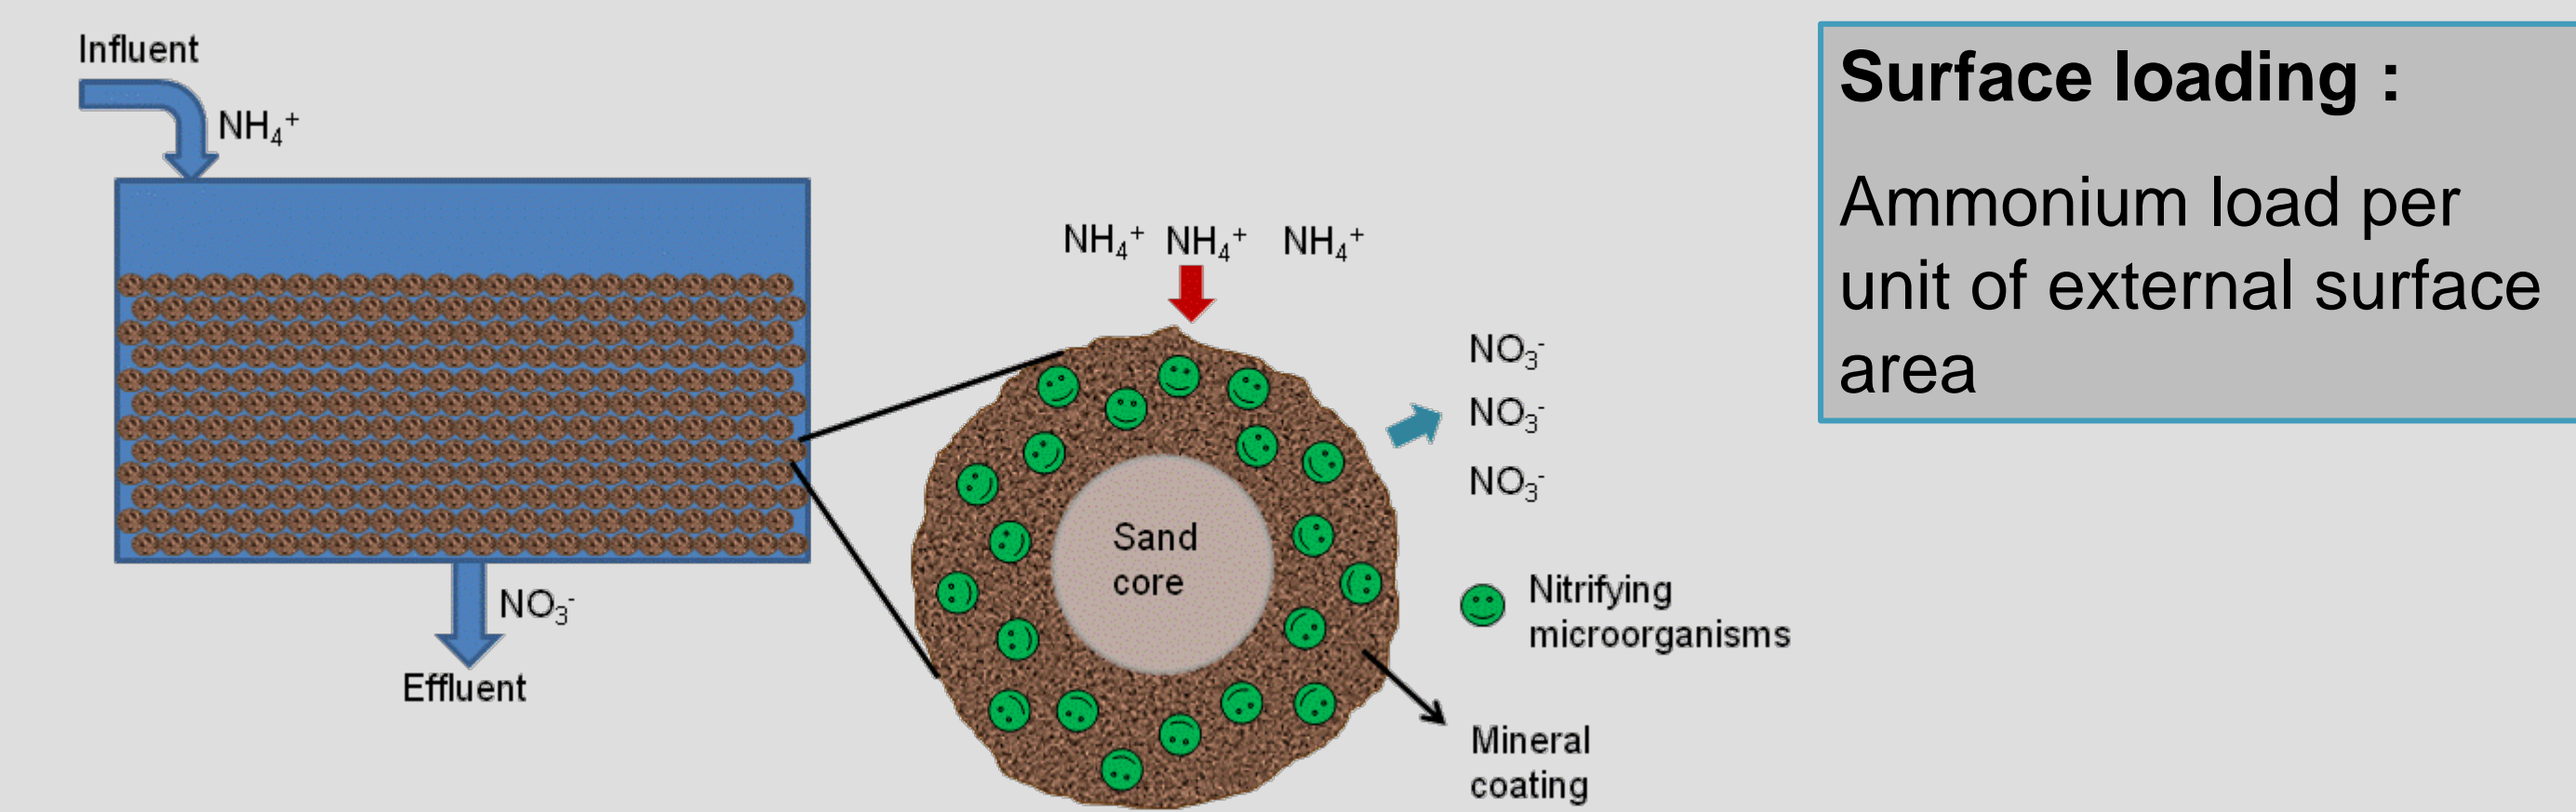


Figure 1: Sketch of nitrification in a rapid sand filter. Ammonium is degraded by a nitrifying biofilm attached on the sand grain surface

Conclusions

- NH_4^+ loading variations below the critical loading had no effect on effluent NH_4^+ concentration
- Once the critical loading was exceeded, effluent NH_4^+ concentration was strongly affected by loading increases
- For the investigated filter, the critical load was 5 times larger than the operating load. Performance of this filter is expected to be robust against load variations

Method

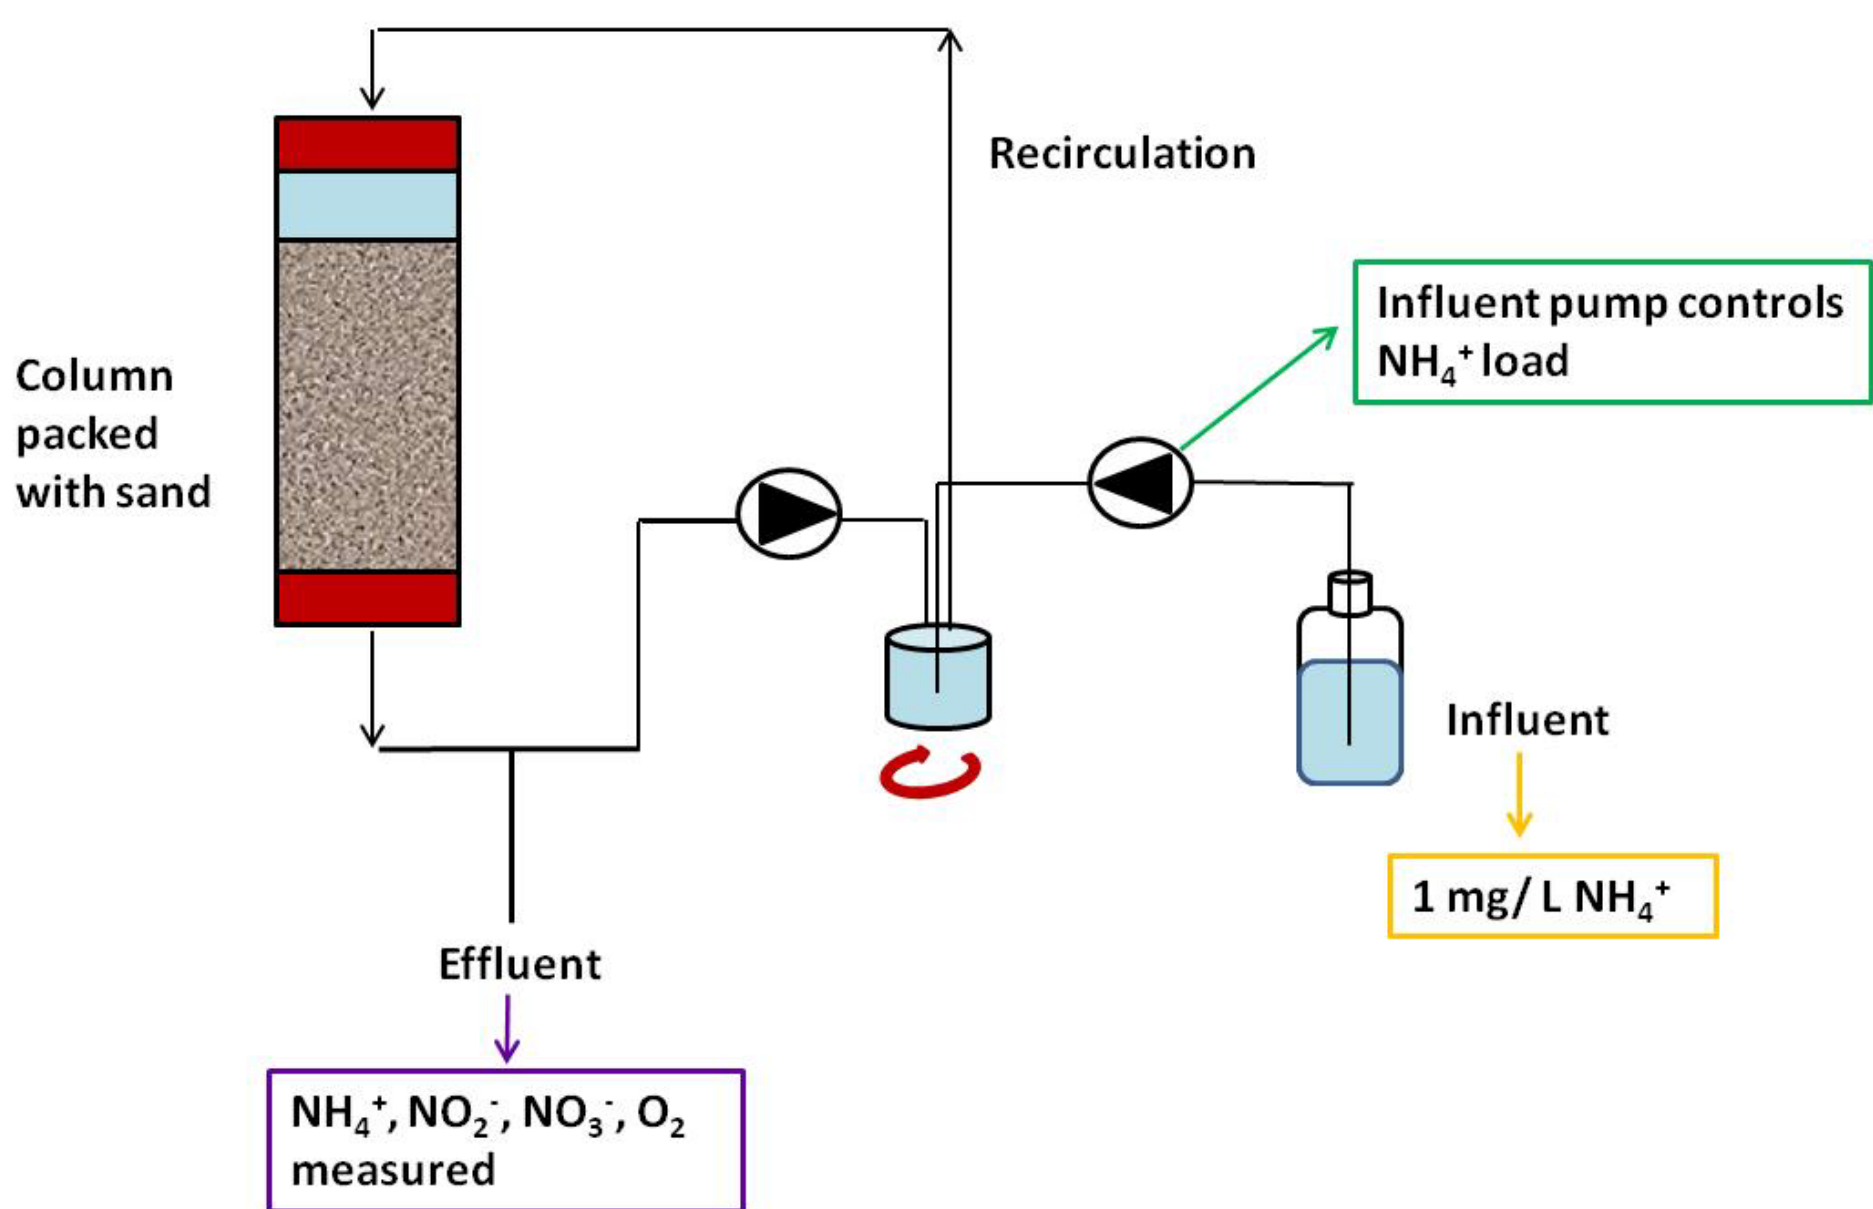


Figure 4: Schematic drawing of experimental set-up. Column dimensions: 5 cm x 2.6 cm ø. Loading was controlled by adjusting influent flow rate, influent concentration was 1 mg/L.

Table 1: Different experimental loads applied. Steady state loading = surface loading of the full scale filter. Duration of experiments was short to avoid growth of nitrifying biomass

Loading (mg $\text{NH}_4^+\text{-N/ m}^2$ sand surface area / h)	Duration of experiment (h)
0.4	steady state
1	5
2	4
4	3

Results

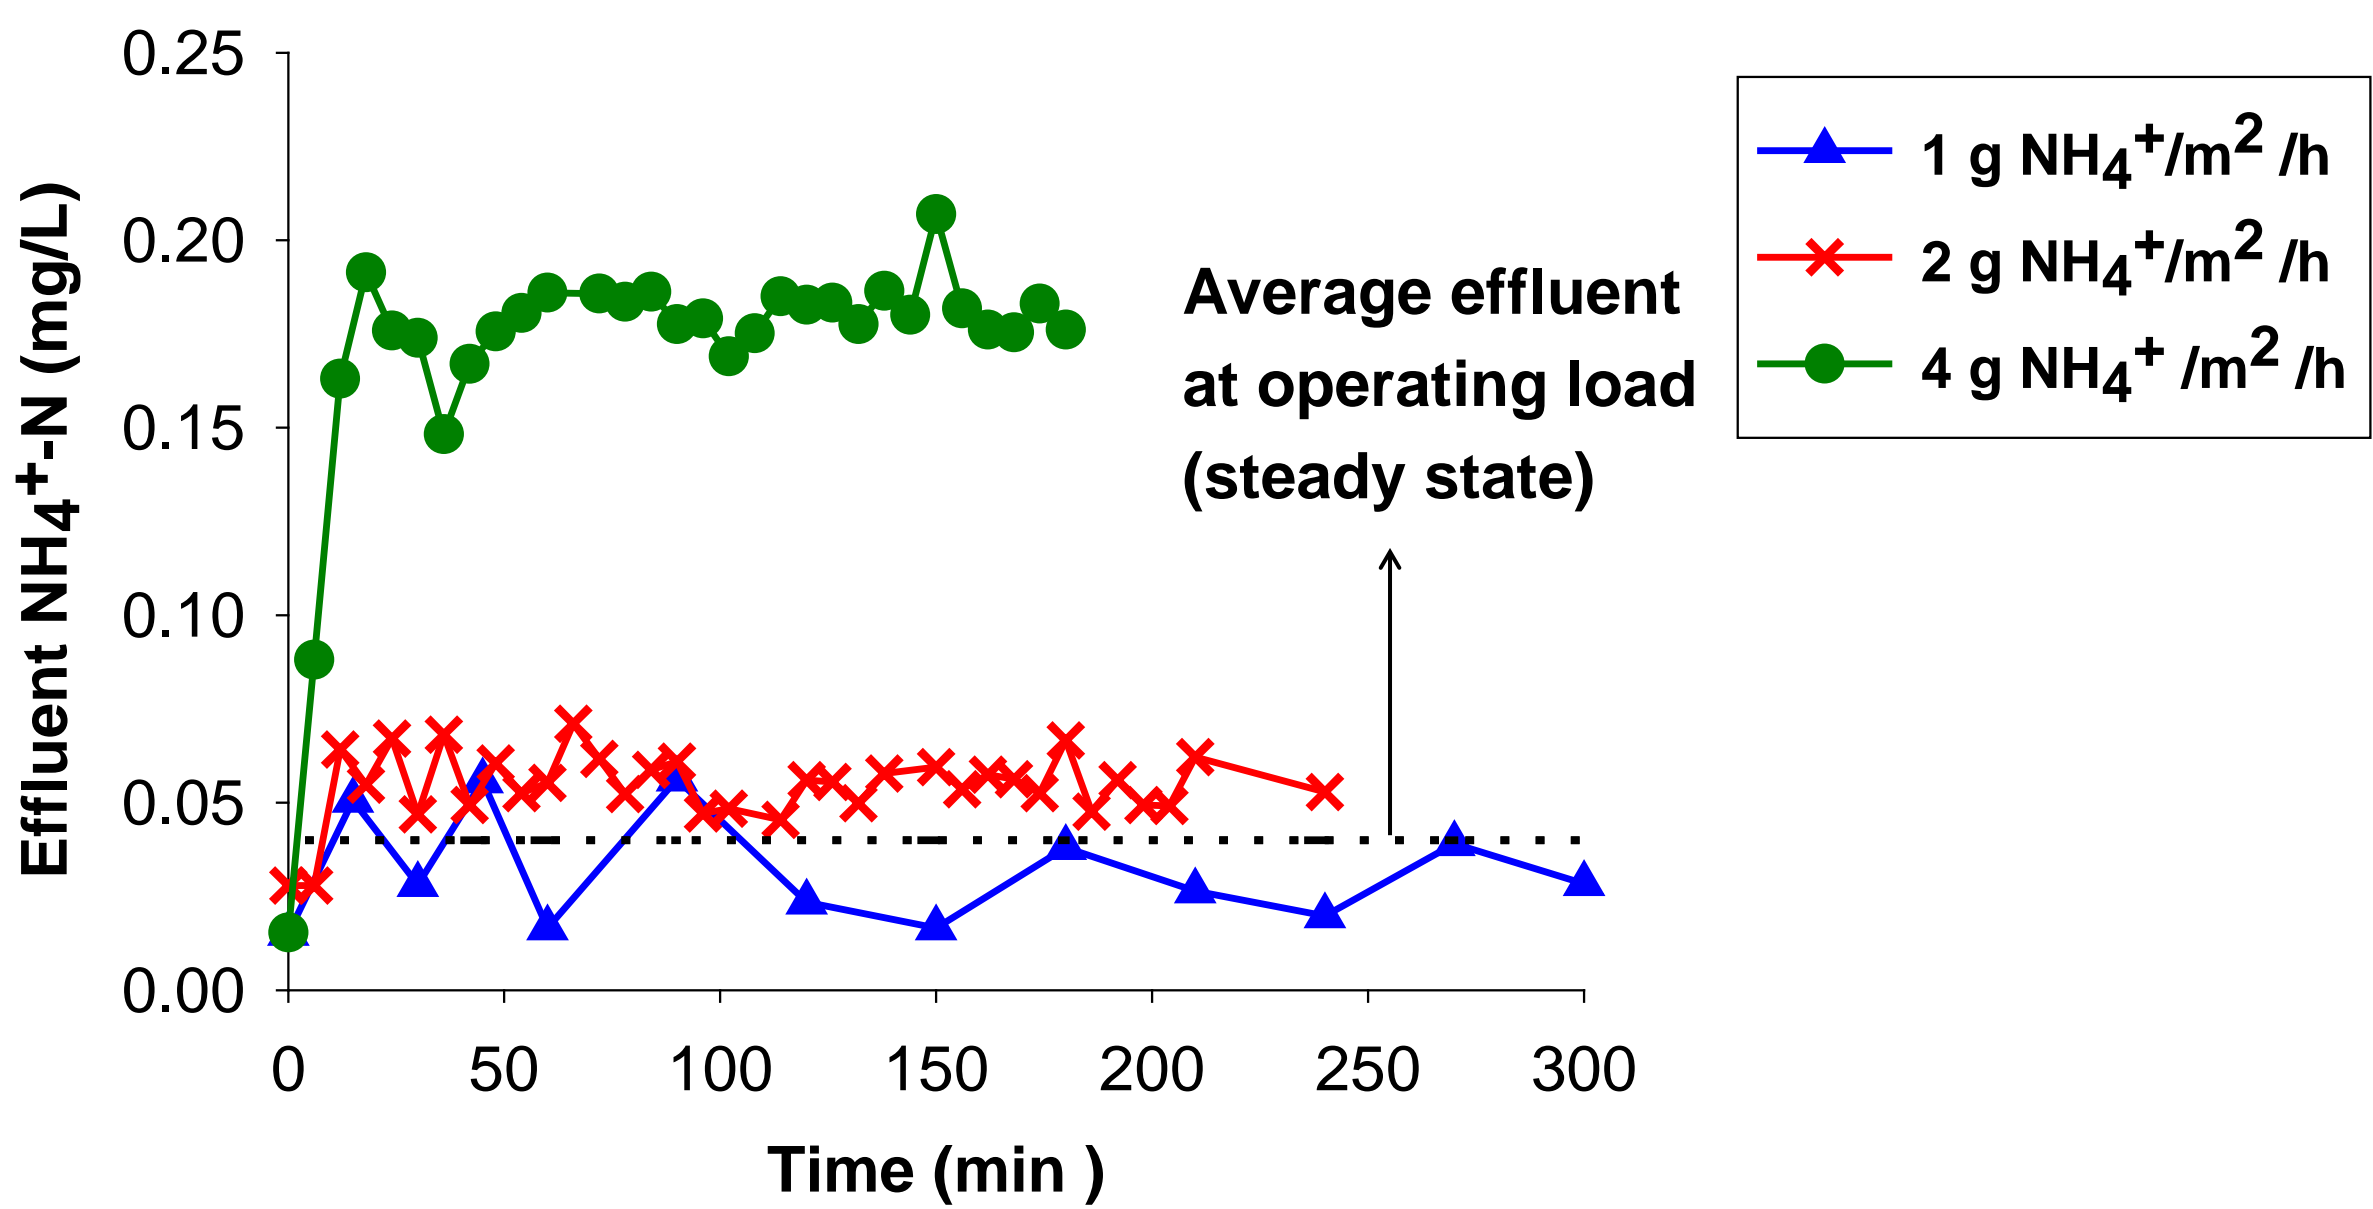


Figure 2: NH_4^+ effluent concentration profile during loading increase experiments. During each loading change ammonium effluent concentration stabilizes to a new value (temporary steady state)

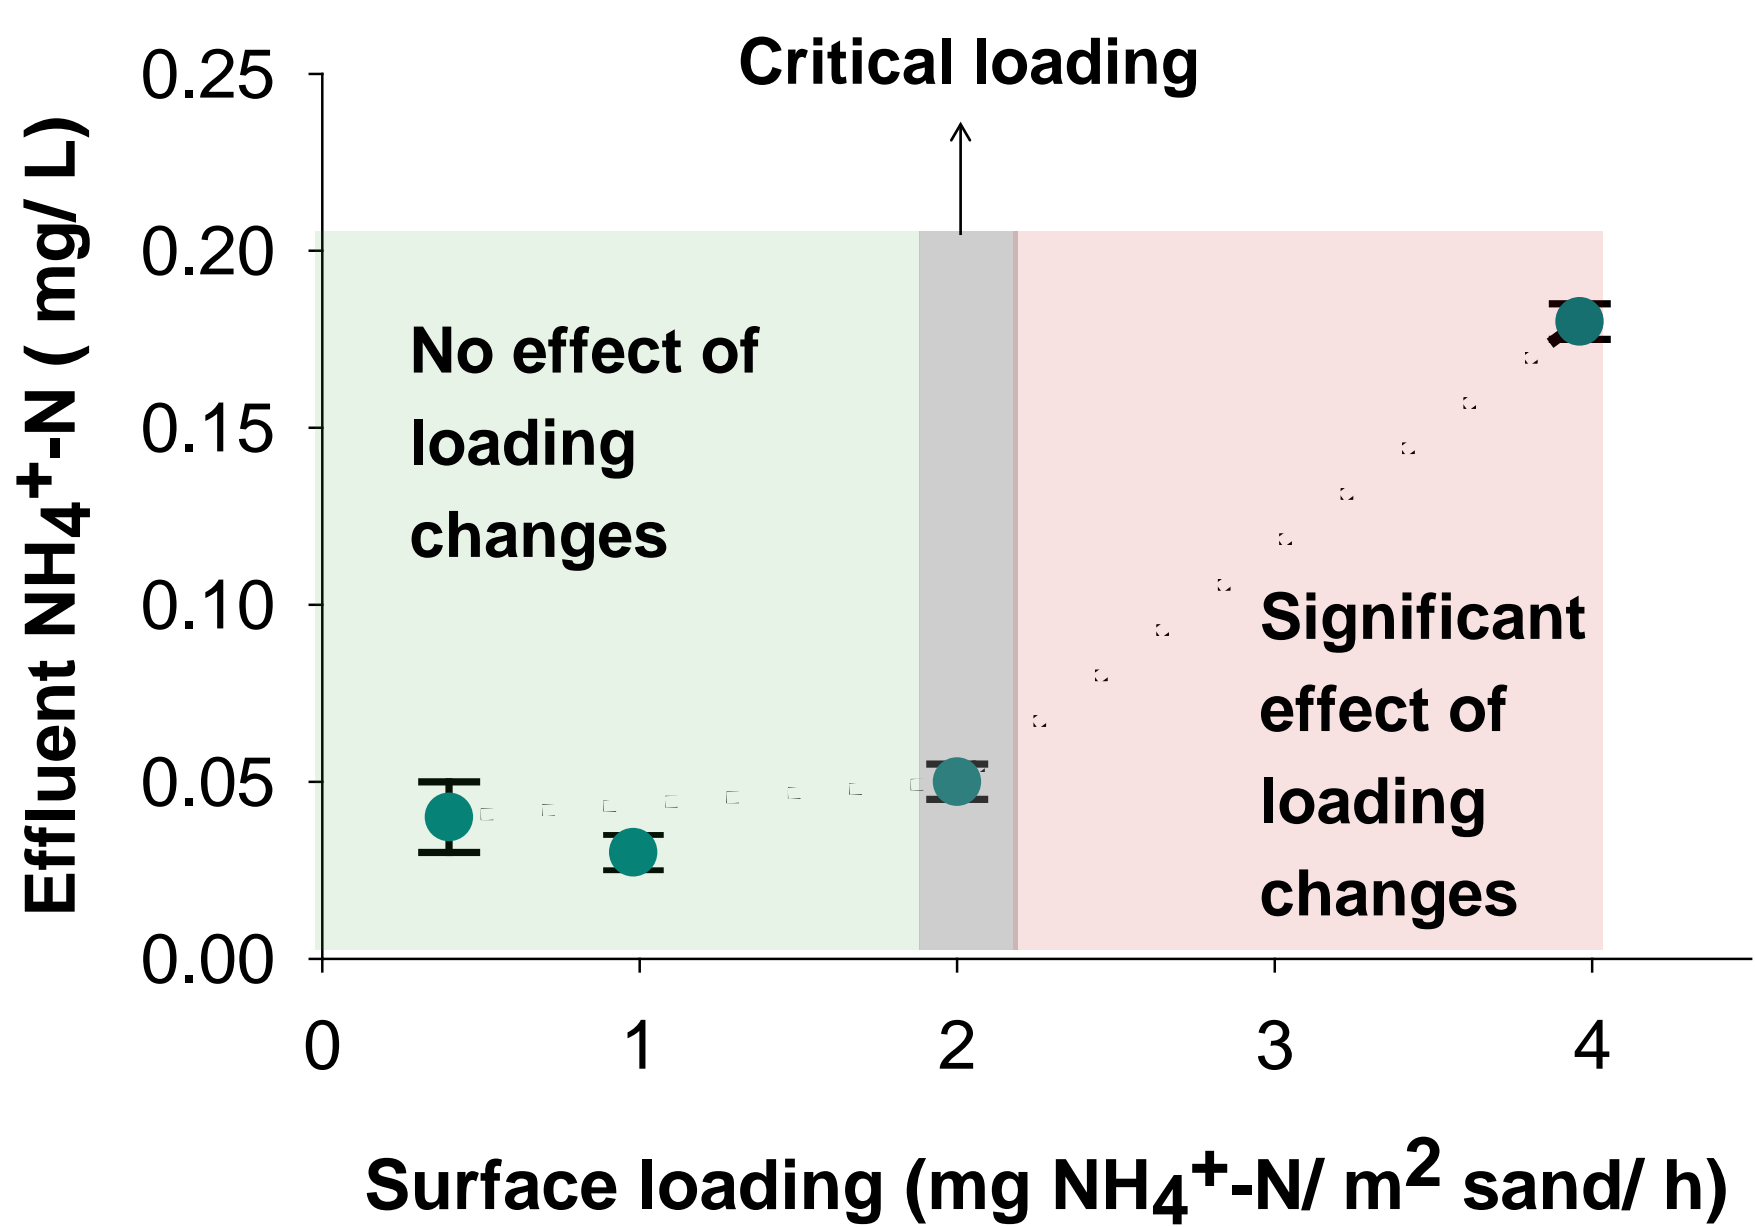


Figure 3: Relationship between NH_4^+ effluent concentration (temporary steady state concentration) and surface loading

- Loadings up to 2 mg $\text{NH}_4^+\text{-N/ m}^2$ / h have no effect on ammonium effluent concentration (t-test, $\alpha = 0.05$)
- Loadings higher than 2 $\text{NH}_4^+\text{-N/ m}^2$ / h result in higher effluent NH_4^+ concentration
- **Critical loading = 2 mg $\text{NH}_4^+\text{-N/ m}^2$ / h**